


SPIRO MÉGA inc.




Oval Access Door

E

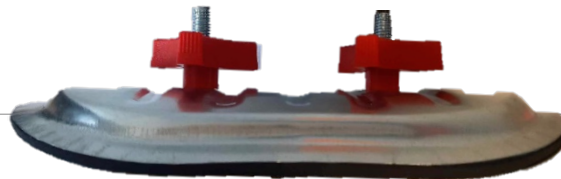

- Tested at 20 inches water gauge with no noted leaks.
- Tested at 10 inches negative water gauge with no noted leaks.

Existing conduct

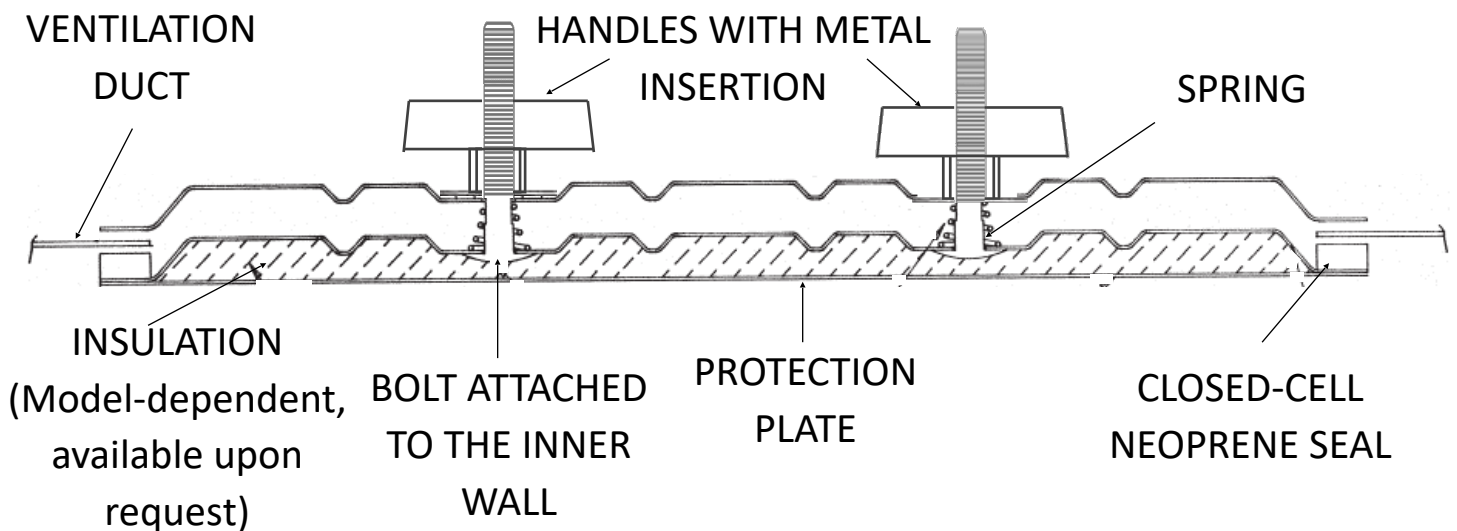

22 GAUGE

In stock